

- ① The sign plate shall be 12" x 18" with a thickness of .080 aluminum construction.
- ② The sign face shall have a white reflective background with a red legend.  
Use oralite 5800 or 5860 with red screen printed lettering as shown.
- ③ Copy to be Frutiger 65 Bold, "Fire Lane".  
Frutiger 55 Roman, "No Parking".  
Frutiger 65 Bold, "By Order Of The Fire Marshal".  
"ORS 811.550"



**A** C1 Details: Fire Lane Sign  
Scale: 3" = 1' -0"

**Woodburn  
Fire District**

Planning and Building OFFICIALS with  
Marion County

**CITY OF WOODBURN  
CITY OF GERVAIS**

**CONTACT:**

James Gibbs  
FIRE MARSHAL  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent  
Drawings**

**TITLE:**

**C1  
Fire Lane Sign**

**DATE:**  
10.23.2018

**BY:**  
The  
Sign  
Shop

**REVISION:**  
XX


**DATE:**  
XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- ① The sign face shall be 12" x 18" with a thickness of .080 aluminum construction with 1 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital fonts. Lettering is 2" x 1/4" stroke.
- ③ The sign face shall have white a 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign imaging shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ Installed knox key box model 1658 next to lock on fire department access door.
- ⑦ Requires pre-approval by City of Woodburn Fire Marshal.

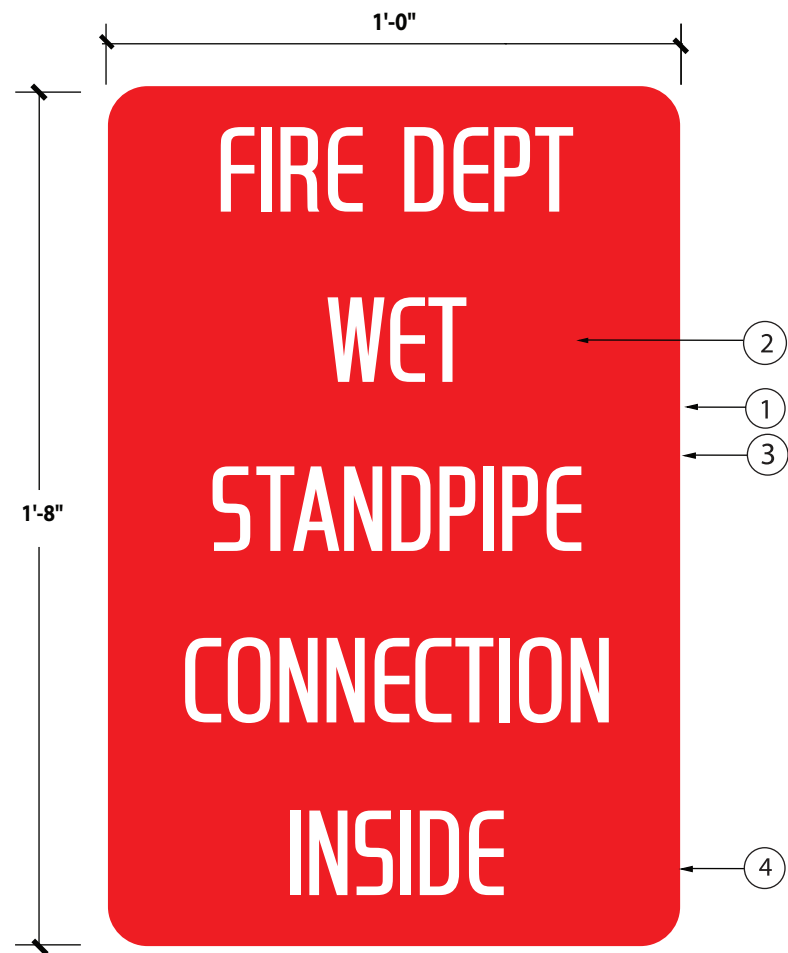

**A** **C2 Details:** Fire Department Wet Standpipe Sign  
Scale: 3" = 1' -0"

**Woodburn  
Fire District**

Planning and Building OFFICIALS with  
Marion County  
**CITY OF WOODBURN  
CITY OF GERVAIS**

**CONTACT:**

James Gibbs  
**FIRE MARSHAL**  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent  
Drawings**

**TITLE:**

**C2  
Fire Department  
Wet Standpipe  
Sign**

**DATE:**  
10.23.2018


**BY:**  
The  
Sign  
Shop

**REVISION:**  
XX


**DATE:**  
XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.

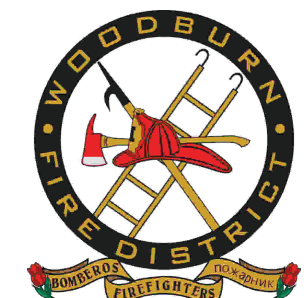

- ① The sign face shall be 8" x 6" with a thickness of .080 aluminum construction with 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital font. Lettering is 1 1/4" x 1/4" stroke.
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ Requires pre-approval by City of Woodburn Fire Marshal.

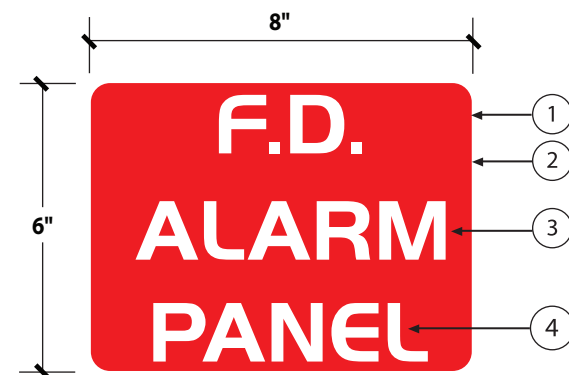

**1** **C3 Details:** Fire Department Alarm Panel Sign  
Scale: 3" = 1' -0"

**Woodburn  
Fire District**

Planning and Building OFFICIALS with  
Marion County  
**CITY OF WOODBURN  
CITY OF GERVAIS**

**CONTACT:**

**James Gibbs**  
**FIRE MARSHAL**  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent  
Drawings**

**TITLE:**

**C3  
Fire Department  
Alarm Panel Sign**

**DATE:**  
10.23.2018

**BY:**  
The  
Sign  
Shop

**REVISION:**  
XX

**DATE:**  
XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- ① The sign face shall be 8" x 6" with a thickness of .080 aluminum construction with 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital font. Lettering is 1 1/4" x 1/4" stroke.
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ Requires pre-approval by City of Woodburn Fire Marshal.



**1** **C4 Details:** Fire Department Access Sign  
 Scale: 3" = 1'-0"

**Woodburn  
 Fire District**

Planning and Building OFFICIALS with  
 Marion County  
**CITY OF WOODBURN  
 CITY OF GERVAIS**

**CONTACT:**

**James Gibbs**  
**FIRE MARSHAL**  
 Phone | 503.982.2360  
 Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent  
 Drawings**

**TITLE:**

**C4**

**Fire Department  
 Access Sign**

**DATE:**  
 10.23.2018


**BY:**  
 The  
 Sign  
 Shop

**REVISION:**  
 XX


**DATE:**  
 XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- ① The sign face shall be 12" x 12" with a thickness of .080 aluminum construction with 1 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital font. Lettering is 3" x 1/2" stroke for "F.D.C." and 1 7/16" x 9/32" stroke for "AUTOSPRK".
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ To be installed on the wall 5-7 feet above grade over F.D.C. inlet.
- ⑦ Requires pre-approval by City of Woodburn Fire Marshal.

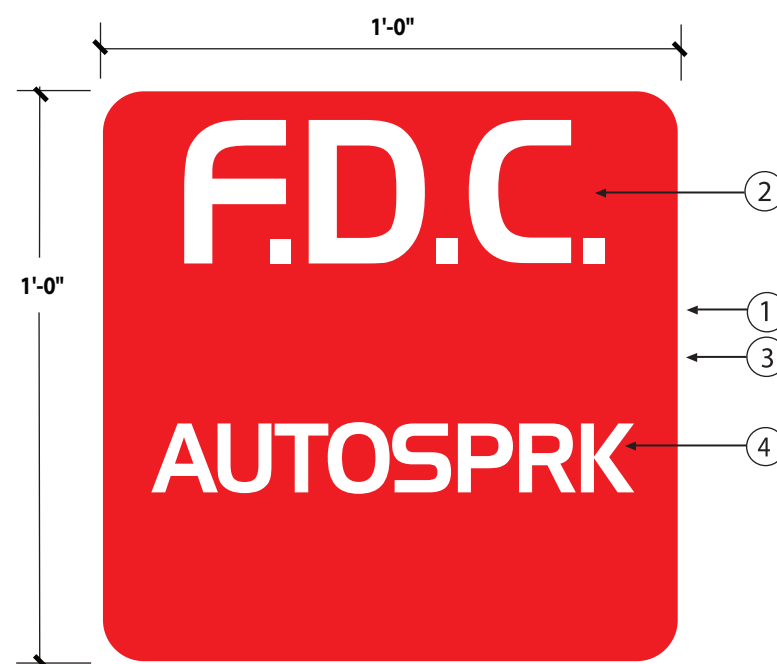

**1** C5 Details:F.D.C. Autosprinkler Sign  
Scale: 3" = 1'-0"

## Woodburn Fire District

Planning and Building OFFICIALS with  
Marion County  
CITY OF WOODBURN  
CITY OF GERVAIS

### CONTACT:

James Gibbs  
FIRE MARSHAL  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

### PROJECT:

**Design Intent**

**Drawings**

### TITLE:

**C5**

**Autosprinkler Sign**

DATE:  
10.23.2018

REVISION:  
XX

BY:  
The  
Sign  
Shop

DATE:  
XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- ① The sign face shall be 12" x 12" with a thickness of .080 aluminum construction with 1 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital font. Lettering is 3" x 1/2" stroke for "F.D.C." and 1 7/16" x 9/32" stroke for secondary text.
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ To be installed on the wall 5-7 feet above grade over F.D.C. inlet.
- ⑦ Requires pre-approval by City of Woodburn Fire Marshal.



**1** C6 Details:F.D.C. Autosprinkler with Building Number Sign  
Scale: 3" = 1' -0"

**Woodburn  
Fire District**

Planning and Building OFFICIALS with  
Marion County  
**CITY OF WOODBURN  
CITY OF GERVAIS**

**CONTACT:**

**James Gibbs**  
**FIRE MARSHAL**  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent  
Drawings**


**TITLE:**

**C6  
Autosprinkler with  
Building Number Sign**


<b>DATE:</b> 10.23.2018	<b>BY:</b> The Sign Shop
<b>REVISION:</b> XX	<b>DATE:</b> XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- ① The sign face shall be 12" x 12" with a thickness of .080 aluminum construction with 1 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital font. Lettering is 3" x 1/2" stroke for "F.D.C." and 1 7/16" x 9/32" stroke for secondary text.
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ To be installed on the wall 5-7 feet above grade over F.D.C. inlet.
- ⑦ Requires pre-approval by City of Woodburn Fire Marshal.

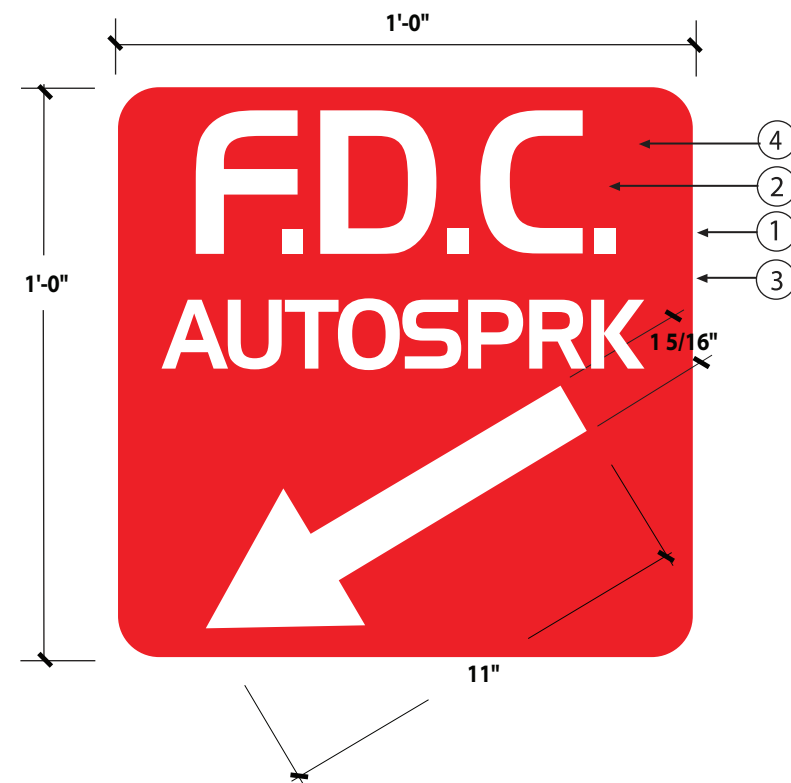

**1** C7 Details:F.D.C. Autosprinkler with Directional Arrow Sign  
Scale: 3" = 1' -0"

**Woodburn  
Fire District**

Planning and Building OFFICIALS with  
Marion County  
**CITY OF WOODBURN**  
**CITY OF GERVAIS**

**CONTACT:**

**James Gibbs**  
**FIRE MARSHAL**  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent**

**Drawings**

**TITLE:**

**C7**

**Autosprinkler with  
Directional Arrow Sign**

**DATE:**  
10.23.2018

**BY:**  
The  
Sign  
Shop

**REVISION:**  
XX

**DATE:**  
XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



**Woodburn  
Fire District**

Planning and Building OFFICIALS with  
Marion County  
**CITY OF WOODBURN  
CITY OF GERVAIS**

**CONTACT:**

**James Gibbs**  
**FIRE MARSHAL**  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent**

**Drawings**

**TITLE:**

**C8**

**Autosprinkler  
Standpipe Signs**

**DATE:**  
10.23.2018


**BY:**  
The  
Sign  
Shop

**REVISION:**  
XX


**DATE:**  
XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- ① The sign face shall be 12" x 12" with a thickness of .080 aluminum construction with 1 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital font. Lettering is 3" x 1/2" stroke for "F.D.C." and 1 7/16" x 9/32" stroke for secondary text.
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ To be installed on the wall 5-7 feet above grade over F.D.C. inlet.
- ⑦ Requires pre-approval by City of Woodburn Fire Marshal.

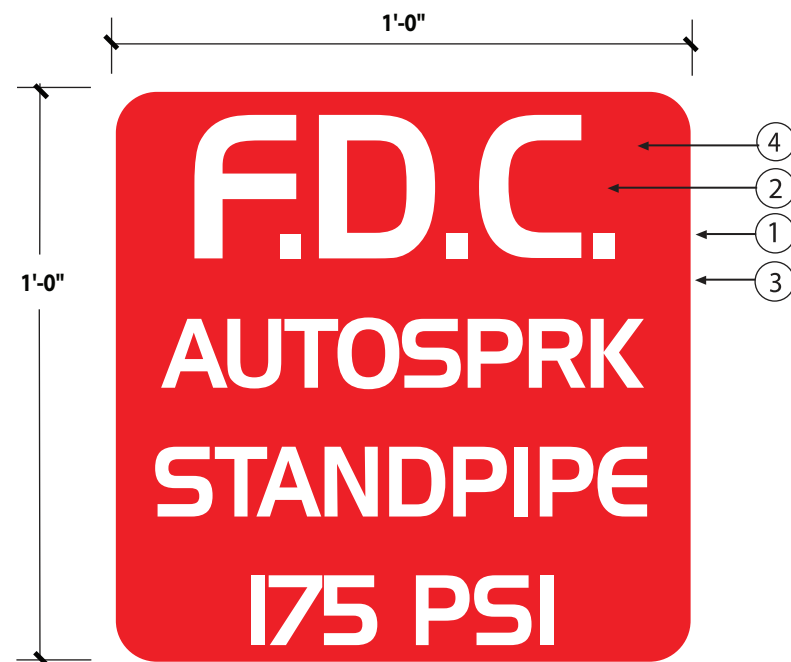


Standard Sign w/ PSI rating  
ESD.1



Standard Sign w/ address  
ESD.2

**A C8 Details: F.D.C. Autosprinkler Standpipe Signs**  
Scale: 3" = 1' -0"

- ① The sign face shall be 12" x 18" with a thickness of .080 aluminum construction with 1 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital font. Lettering is 1 3/4" for "DO NOT", "INTO", and "THESE"; 2" for "PUMP"; 1 11/16" for "FITTINGS".
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ Mount on all four corners.
- ⑦ Requires pre-approval by City of Woodburn Fire Marshal.

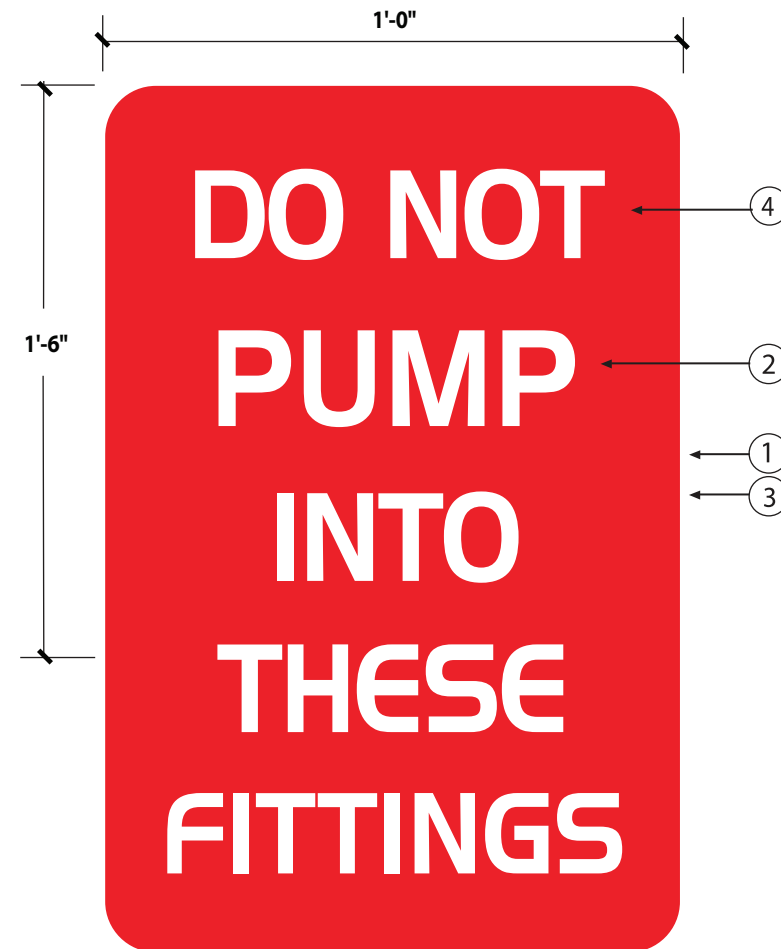

**A** C9 Details: F.D.C. Do Not Pump Sign  
Scale: 3" = 1'-0"

## Woodburn Fire District

Planning and Building OFFICIALS with  
Marion County  
**CITY OF WOODBURN**  
**CITY OF GERVAIS**

### CONTACT:

**James Gibbs**  
**FIRE MARSHAL**  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

### PROJECT:

**Design Intent**

**Drawings**

### TITLE:

**C9**

**Do Not Pump Sign**

**DATE:**  
10.23.2018

**BY:**  
The  
Sign  
Shop

**REVISION:**  
XX


**DATE:**  
XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- ① The sign face shall be 12" x 12" with a thickness of .080 aluminum construction with 1 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital font. Lettering is 1 1/2" X .344 stroke, additional kerning between letters (between 5/16" and 3/8").
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ Requires pre-approval by City of Woodburn Fire Marshal.

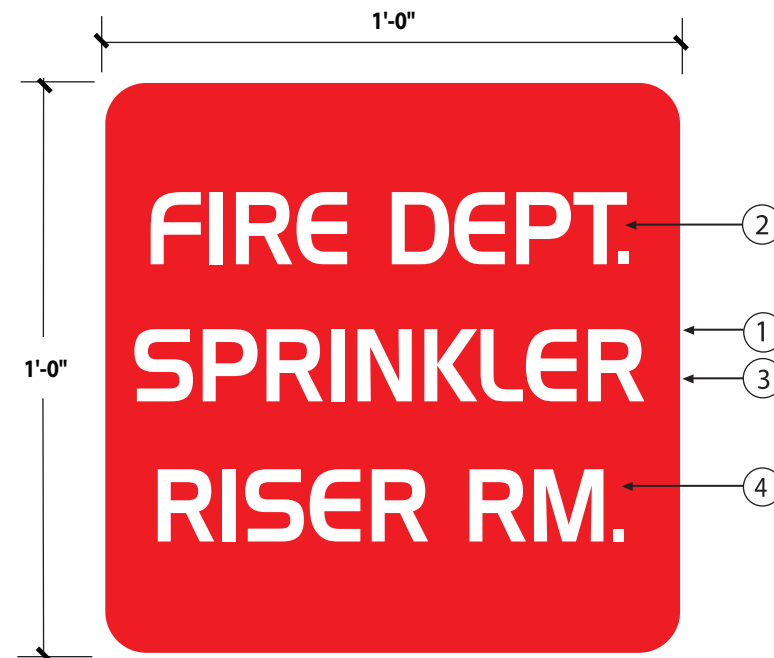

**A** C10 Details: Sprinkler Riser Room Sign  
Scale: 3" = 1' -0"

**Woodburn  
Fire District**

Planning and Building OFFICIALS with  
Marion County  
**CITY OF WOODBURN  
CITY OF GERVAIS**

**CONTACT:**

**James Gibbs**  
**FIRE MARSHAL**  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent**

**Drawings**

**TITLE:**

**C10**

**Sprinkler Riser**

**Room Sign**

**DATE:**  
10.23.2018


**BY:**  
The  
Sign  
Shop

**REVISION:**  
XX

**DATE:**  
XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- ① The sign face shall be 12" x 12" with a thickness of .080 aluminum construction with 1 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital font. Lettering is 1 1/2" X .344 stroke, additional kerning between letters (between 5/16" and 3/8").
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ Requires pre-approval by City of Woodburn Fire Marshal.



**A** C11 Details: Command Center Sign  
Scale: 3" = 1' -0"

**Woodburn  
Fire District**

Planning and Building OFFICIALS with  
Marion County

**CITY OF WOODBURN  
CITY OF GERVAIS**

**CONTACT:**

**James Gibbs**  
**FIRE MARSHAL**  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent  
Drawings**

**TITLE:**

**C11  
Command Center  
Sign**

**DATE:**  
10.23.2018

**BY:**  
The  
Sign  
Shop

**REVISION:**  
XX

**DATE:**  
XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.





Notes:

- ① The sign face shall be 12" x 14" and fabricated from .080 aluminum sheet with 1 1/2" radius corners.
- ② Font style used is Frutiger 55 Roman capitals fonts.
- ③ The sign face shall have a White 3M Diamond Grade Reflective Sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering/Graphics shall be high performance, non-reflective cuttable vinyl (3M 7725 Series) inverse cut to allow white reflective background to show through.
- ⑤ All sign imaging shall be in compliance with the reflective sheeting manufacturers match component system.

**ADA Disclaimer:**

The information provided on the bottom of 2" portion of this sign is only intended to aid people with visual impairments exiting the building. The braille and raised #'s indicating stairwell location and floor number meets ADA Requirements for directional signage. Additional information displayed on the sign is intended for F.D. use only.

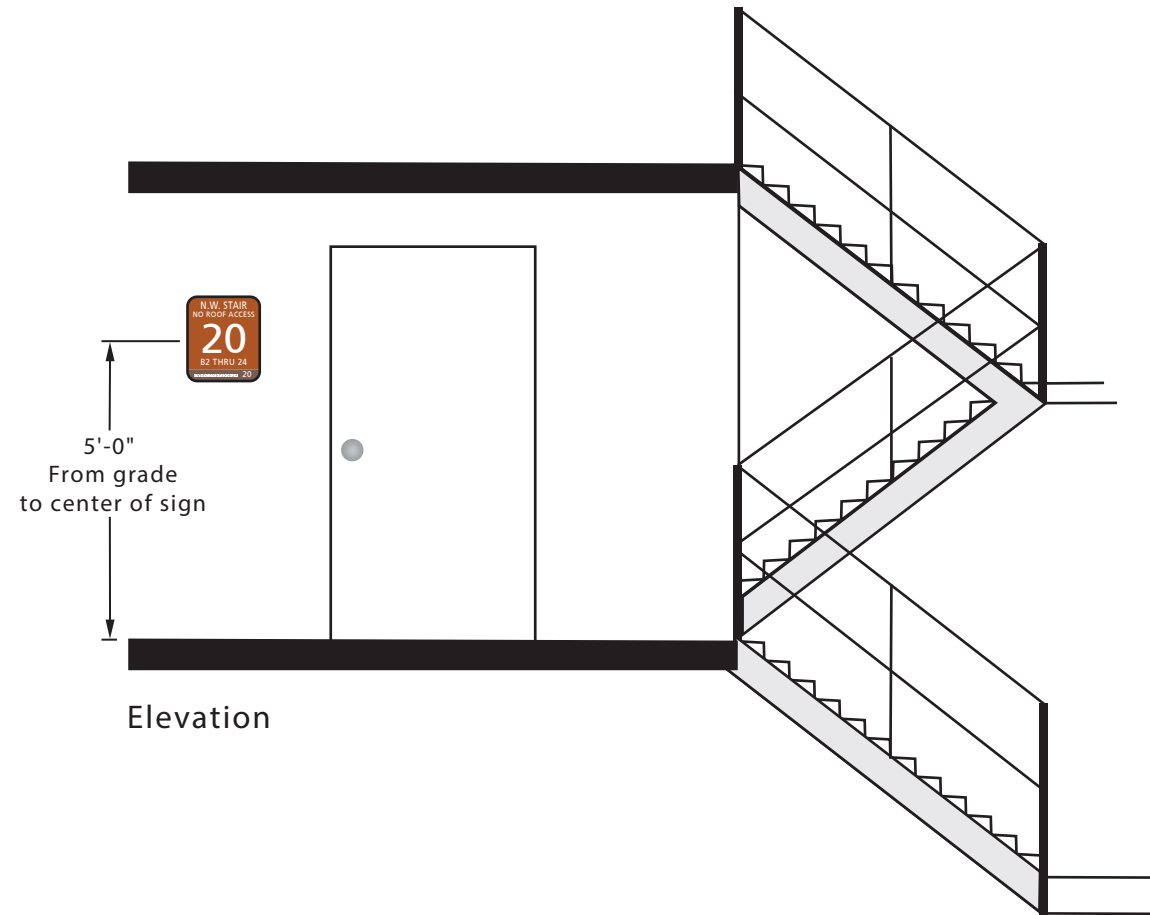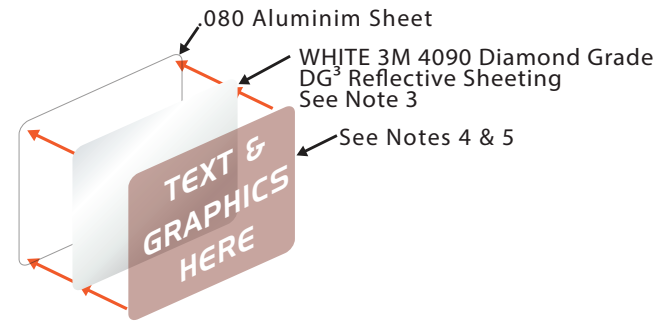

**Woodburn Fire District**

Planning and Building OFFICIALS with Marion County  
**CITY OF WOODBURN**  
**CITY OF GERVAIS**

**CONTACT:**


James Gibbs  
**FIRE MARSHAL**  
 Phone | 503.982.2360  
 Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent Drawings**

**TITLE:**

**C12 Stairwell Signage**

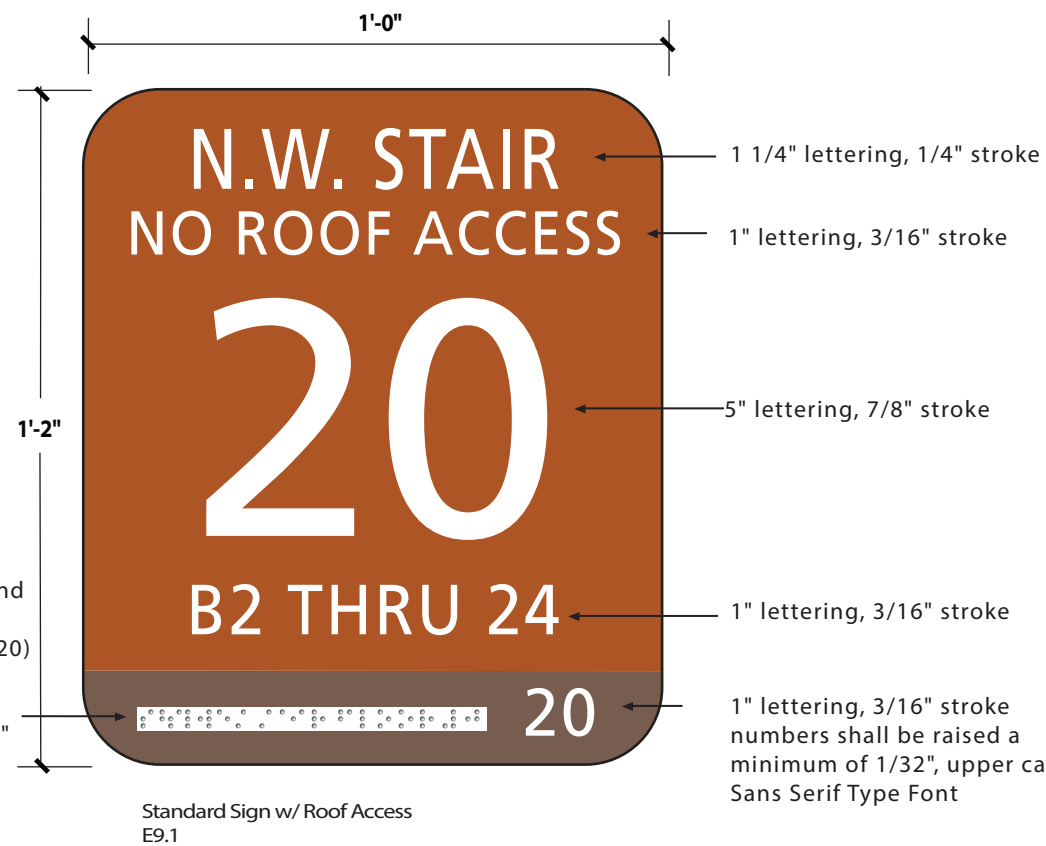

**DATE:**  
 10.23.2018

**BY:**  
 The Sign Shop

**REVISION:**  
 XX


**DATE:**  
 XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- ① The sign face shall be 48" x 48" with a thickness of .080 aluminum constructin with 1 1/2" radius corners. The lower half of the sign plate is not required to be red reflective sheeting. This sign can be revised and transferred from site to site.
- ② 6" white lettering shall be 3M Scotchal high performance opaque film , series 7725.
- ③ .080 aluminum background with red 3M Scotchlite engineer grade reflective film, series 3200.
- ④ Seperate removable .080 aluminum sign plate. White lettering shall be 3M Schotchal high performance opaque film, series 7725. Lettering shall be large enough to be easily readable from a distance of 200 to 300 feet. Background shall be 3M Scotchal high performance opaque film, series 7725 (non-reflective) color to be red or a color of equally high contrast to white lettering.
  - Copy is to identify the floweing:
    - Name of homes or business
    - Address of property
    - Site superintendent’s name and cell phone number or phone number of responsible party.
- ⑤ 4" x 4" wood post painted.

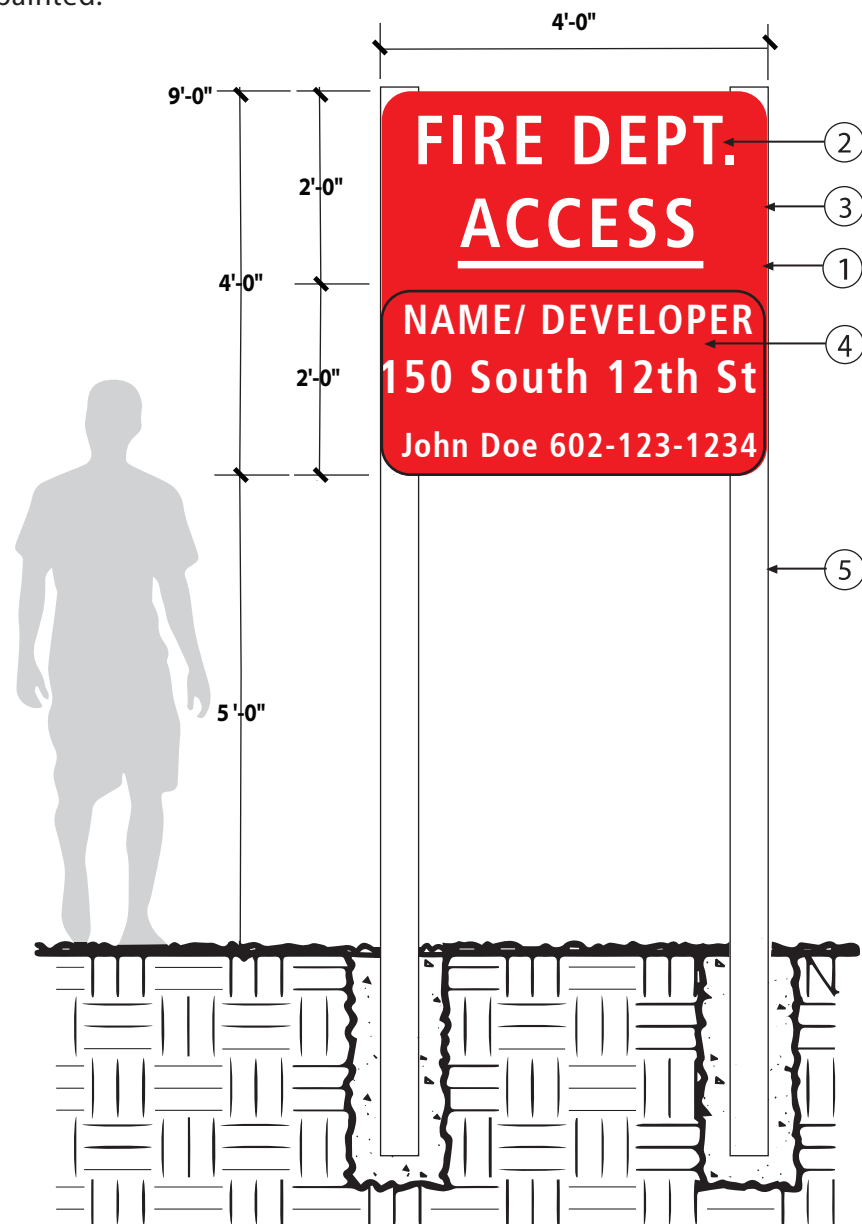

## Woodburn Fire District

Planning and Building OFFICIALS with  
Marion County  
**CITY OF WOODBURN**  
**CITY OF GERVAIS**

### CONTACT:

**James Gibbs**  
**FIRE MARSHAL**  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

### PROJECT:

## Design Intent Drawings

### TITLE:

**C13**

## Construction Access Sign

**DATE:**  
10.23.2018


**BY:**  
The  
Sign  
Shop

**REVISION:**  
xx


**DATE:**  
xx.xx.xxxx

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- ① The sign face shall be 8" x 8" with a thickness of .080 aluminum constructin with 1 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital fonts. Lettering is 3" x 1/2" stroke for "KNOX BOX".
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ Requires pre-approval by City of Woodburn Fire Marshal.

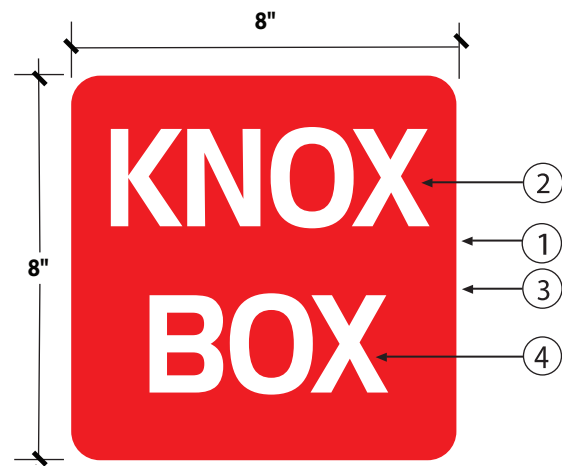

**1 C14 Details: Knox Box Sign**  
 Scale: 3" = 1'-0"

**Woodburn  
Fire District**

Planning and Building OFFICIALS with  
Marion County

**CITY OF WOODBURN  
CITY OF GERVAIS**

**CONTACT:**

**James Gibbs**  
**FIRE MARSHAL**  
 Phone | 503.982.2360  
 Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent**

**Drawings**

**TITLE:**

**C14**

**Knox Box**

**Sign**

**DATE:**  
10.23.2018


**BY:**  
The  
Sign  
Shop

**REVISION:**  
XX


**DATE:**  
XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- ① The sign face shall be 8" x 8" with a thickness of .080 aluminum constructin with 1 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital fonts. Lettering is 1 1/2" x .344" stroke, additonal kerning between letters (between 5/16 and 3/8).
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ Requires pre-approval by City of Woodburn Fire Marshal.

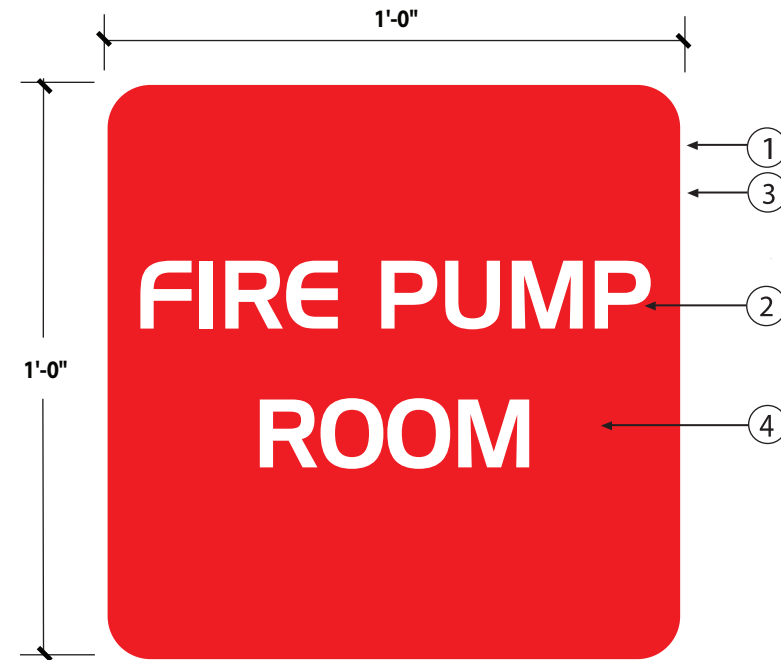

**1** C15 Details: Fire Pump Room Sign  
Scale: 3" = 1' -0"

## Woodburn Fire District

Planning and Building OFFICIALS with  
Marion County  
CITY OF WOODBURN  
CITY OF GERVAIS

### CONTACT:

James Gibbs  
FIRE MARSHAL  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

### PROJECT:

**Design Intent**

**Drawings**

### TITLE:

**C15**

**Fire Pump**

**Room Sign**

DATE:  
10.23.2018


BY:  
The  
Sign  
Shop

REVISION:  
XX

DATE:  
XX.XX.XXXX

This drawing is provided to  
communicate design  
information. It is not to be  
interpreted as a construction  
document.

The manufacturer is responsible  
for providing shop drawings  
and construction specifications.



- ① The sign face shall be 8" x 8" with a thickness of .080 aluminum constructin with 1 1/2" radius corners.
- ② Font style used is Handel Gothic BT capital fonts. Lettering is 2" x 3\8" stroke.
- ③ The sign face shall have a white 3M diamond grade reflective sheeting (DG<sup>3</sup> 4090 series or equivalent) applied as a background to the aluminum plates.
- ④ Lettering shall be done one of the following ways:
  - A. 3M Scotchlite acrylic, transparent, electronic cuttable film (Red 1172 series) inverse cut to allow white reflective background to show through.
  - B. Screen printed using 3M 880 I or 880-00 series traffic sign red translucent ink.
 Both processes (A or B) will accomplish a red field with white copy.
- ⑤ All sign material shall be in compliance with the reflective sheeting manufacturers match component system.
- ⑥ Requires pre-approval by City of Woodburn Fire Marshal.



**① C16 Details: FAAP Sign**  
Scale: 3" = 1' -0"

**Woodburn  
Fire District**

Planning and Building OFFICIALS with  
Marion County  
**CITY OF WOODBURN  
CITY OF GERVAIS**

**CONTACT:**

**James Gibbs**  
**FIRE MARSHAL**  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent  
Drawings**

**TITLE:**

**C16  
FAAP Sign**

**DATE:**  
10.23.2018


**BY:**  
The  
Sign  
Shop

**REVISION:**  
XX


**DATE:**  
XX.XX.XXXX

This drawing is provided to communicate design information. It is not to be interpreted as a construction document.

The manufacturer is responsible for providing shop drawings and construction specifications.



- 1 The sign plate shall be 12" x 18" with a thickness of .080 aluminum construction.
- 2 The sign face shall have a white reflective background with a red legend.  
Use oralite 5800 or 5860 with red screen printed lettering as shown.

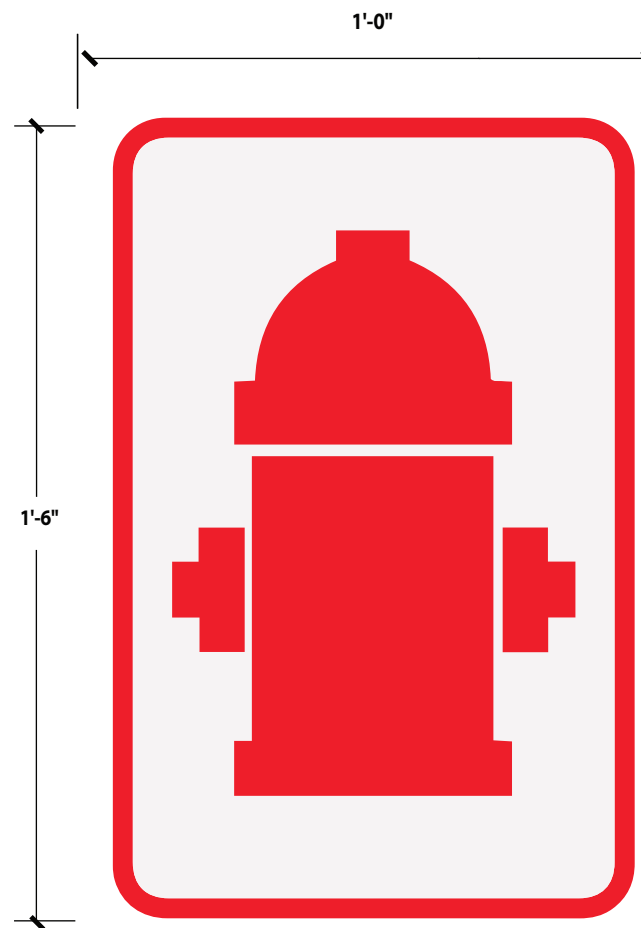

**A** **C17 Details:** Indication of Fire Hydrant Sign  
Scale: 3" = 1' -0"

**Woodburn  
Fire District**

Planning and Building OFFICIALS with  
Marion County

**CITY OF WOODBURN  
CITY OF GERVAIS**

**CONTACT:**

James Gibbs  
FIRE MARSHAL  
Phone | 503.982.2360  
Email | gibbsj@woodburnfire.com

**PROJECT:**

**Design Intent  
Drawings**

**TITLE:**

**C1  
Indication of  
Fire Hydrant  
Sign**

**DATE:**  
10.23.2018

**REVISION:**  
XX

**BY:**  
The  
Sign  
Shop

**DATE:**  
XX.XX.XXXX

This drawing is provided to  
communicate design  
information. It is not to be  
interpreted as a construction  
document.

The manufacturer is responsible  
for providing shop drawings  
and construction specifications.

